


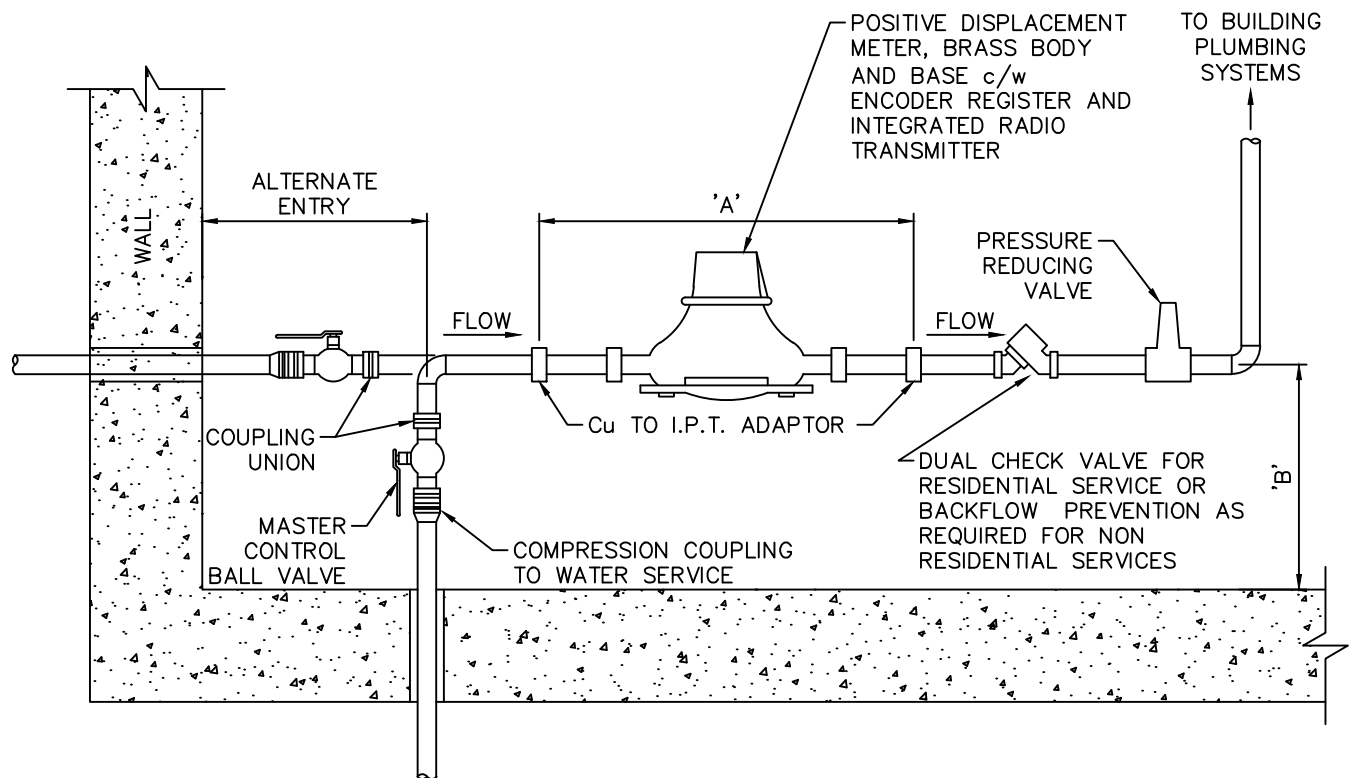

TYPICAL METER SETTING USING COPPER PIPE

METER SIZE	'A' mm	'A' MAX mm	'B' MAX mm	MANUFACTURER
16mmx19mm	318	318	318	NEPTUNE T-10 c/w E-CODER R900i
19mm	362	362	362	NEPTUNE T-10 c/w E-CODER R900i
25mm	413	413	413	NEPTUNE T-10 c/w E-CODER R900i

NOTES

1. PIPING ON EACH SIDE OF METER MUST BE ADEQUATELY SUPPORTED.
2. PIPING FOR METER MUST BE ON A HORIZONTAL PLANE.
3. MINIMUM DISTANCE OF 300mm BETWEEN ANY WALL AND A METER.
4. THE AREA 600mm IN FRONT OF THE METER SHALL BE FREE OF OBSTRUCTION TO ALLOW FOR CONVENIENT READING AND SERVICING OF THE METER.
5. METERS MUST BE INSTALLED IN THE MECHANICAL ROOM AND WITHIN REASONABLE DISTANCE OF A FLOOR DRAIN. IN NO CASE SHALL A METER BE INSTALLED IN A BATHROOM OR BEDROOM.
6. THE MASTER CONTROL BALL VALVE AND DUAL CHECK VALVE SHALL CONFORM TO THE B.C. PLUMBING CODE.
7. INSTALLATION OF FLASHING OR METAL SHEETING IN THE AREA OF THE METER IS NOT PERMITTED IN ORDER TO AVOID INTERFERENCE WITH THE RADIO TRANSMITTER.
8. WATER METERS SHALL BE PURCHASED FROM TOWN OF OLIVER.

TOWN OF OLIVER

TYPICAL INSIDE
WATER METER INSTALLATION



DWN. BY:	JOSEPH
CHK. BY:	SHAWN
DATE:	MARCH 2021
SCALE:	N.T.S.
DWG. NO.:	REV.:
W-11	1